


DUAL CHANNEL REMOTE SPOT WATER DETECTOR

Installation Instructions

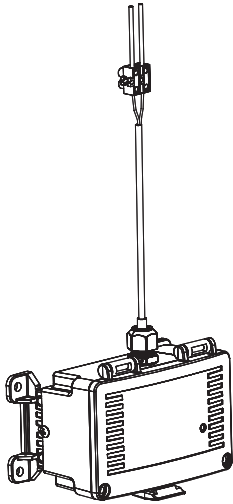

INTRODUCTION


The dual channel remote spot water detector is used to detect the presence of water or conductive liquids. It features two sensing points, each with an independent relay output and is designed to signal alarms if one or more of three conditions are met: water is detected, power is lost to the unit, or if there is an internal failure.

The dual channel remote spot water detector features remote spot detection on channel 1 with remote sensing probes and cable that is available in various lengths. On Channel 2, can be selected as either a secondary remote spot or with conductivity cable which is available in several lengths.


It is housed in an IP65 rated enclosure with height adjustable mounting legs. A tri-color LED provides visual status indication.

BEFORE INSTALLATION


- Read these instructions carefully before installing and commissioning the water detector. Failure to follow these instructions may result in product damage.
- Do not use in an explosive or hazardous environment, with combustible or flammable gases, as a safety or emergency stop device or in any other application where failure of the product could result in personal injury.
- **Take electrostatic discharge precautions during installation and do not exceed the device ratings.**

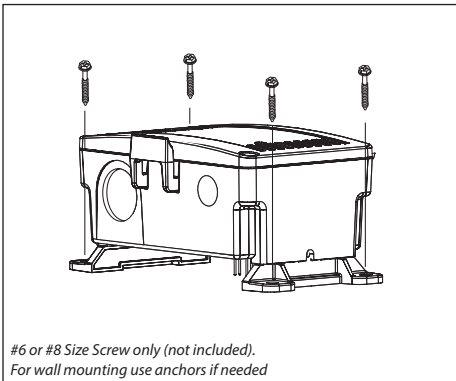


1 Secure by applying a silicone adhesive to the mounting feet and placing the sensor in the area to be protected. For more permanent installations, fasten the sensor using the holes provided in the mounting feet.

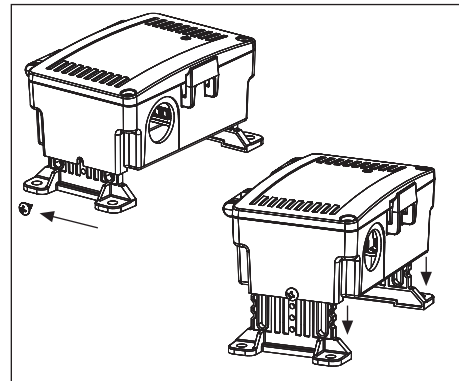


2 The legs have five pre-set heights set by the holes in the leg. To adjust leg height, remove the screws. Pull/push the legs to the height desired, and re-insert screws and tighten.

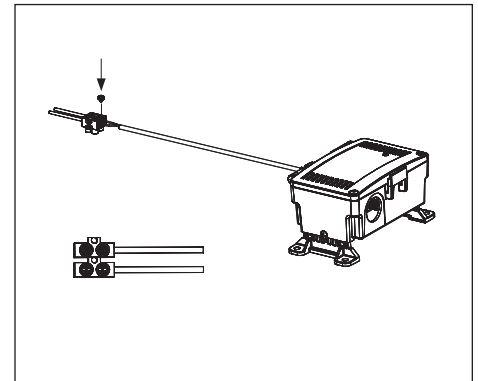


3 Route the cable to desired location. Mount the terminal block using a screw or adhesive. Make sure sensing probes do not contact any surface. Repeat for Channel 2 if Remote Spot is selected.

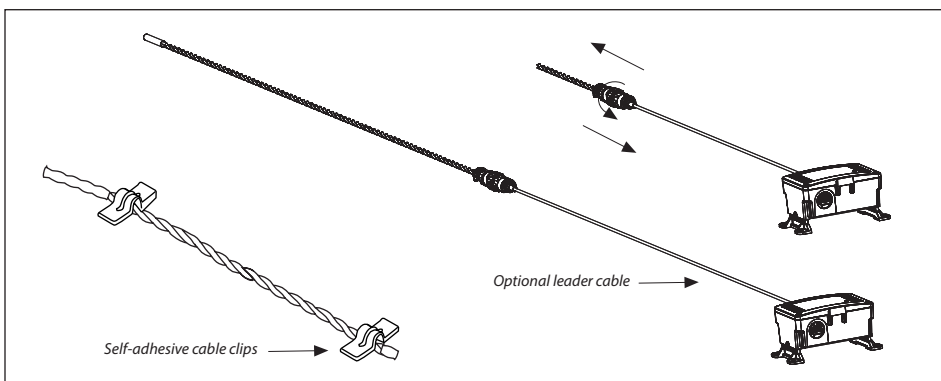


4 If Channel 2 is Conductivity Cable, Once laid in place, secure using the self-adhesive cable clips provided. For best results adhere clips at each end of the cable first. Clips are provided to secure cable approximately every 1.5 m (5'). NOTE: If the device was ordered with a leader cable, the conductivity cable can be disconnected to assist in installation. To remove, twist connector counter-clockwise and pull apart.

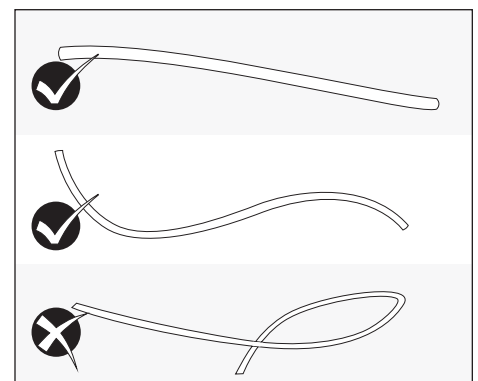


5 The cable may be laid in a straight line or in a serpentine configuration. Be careful not to kink cable.

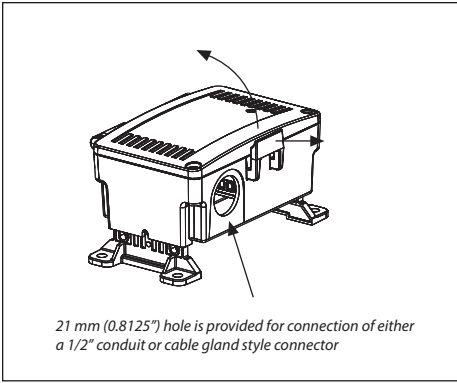

6 Open the cover by pulling slightly on the latch on the enclosure and at the same time pulling up on the cover.

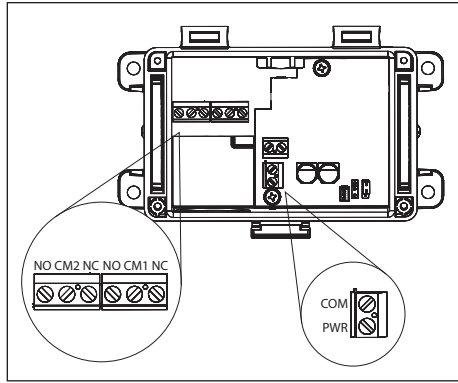


7 Make all connections in accordance with national and local codes. Use 14-22 AWG shielded wire and do not locate the device wires in the same conduit with wiring used to supply inductive loads such as motors. The device is reverse voltage protected and will not operate if connected backwards.

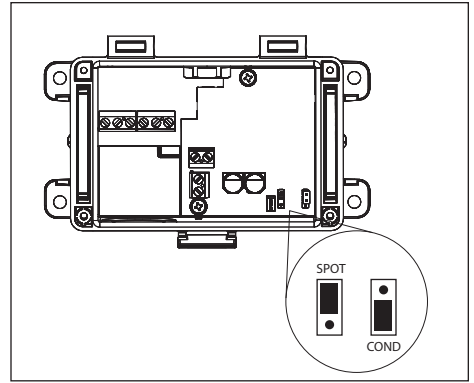

8 All jumpers are factory set. Improper positioning will cause device to be in constant alarm state.

Spot = SPOT position
Remote Spot = SPOT position
Conductivity Cable = COND position

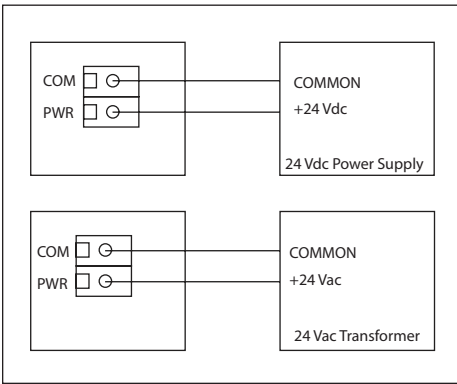

9 To prevent electrical shock or equipment damage make all connections before applying power. Connect 24 Vac/Vdc to PWR & COM terminals.

NOTE: Use caution when wiring multiple devices or when grounding the secondary of a transformer to ensure that the circuit ground point is the same on all devices and the controller.


OPERATION

When the sensor is powered on the controller will monitor the liquid detection channels. If a conductive liquid comes in contact with the sensor pins or conductive cable the controller will trigger the relays to indicate liquid is present.

The relays are fail-safe, meaning when power is applied to device the relay is powered. If power is lost to device the relay will deenergize signaling a fault to the system.


- Channel 1:** Relay Activates on water detection.
- Channel 2:** Remote Spot: Relay activates on water detection.
- Channel 2:** Conductivity: Relay activates on water detection or trouble.

- LED:** Green = No water detected
- Yellow Solid = Channel 1 Water Detection
- Red Solid = Channel 2 Water Detection
- Red Flash = Channel 2 Trouble (Conductivity Cable Only)

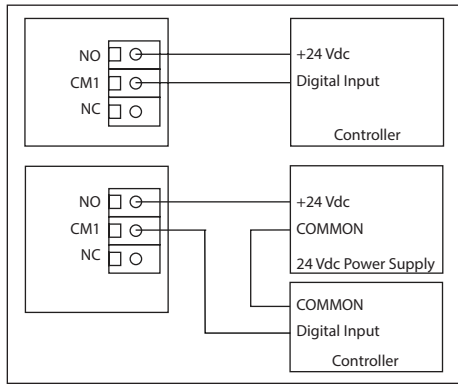


10 Do not exceed the device contact ratings. The relays are Form C type with both a normally open (NO) and a normally closed (NC) contact. Relay terminals are designated NO, CM* and NC.

NOTE: Each relay output is independent and isolated from the other and the relays COMs are not connected to the device COM.

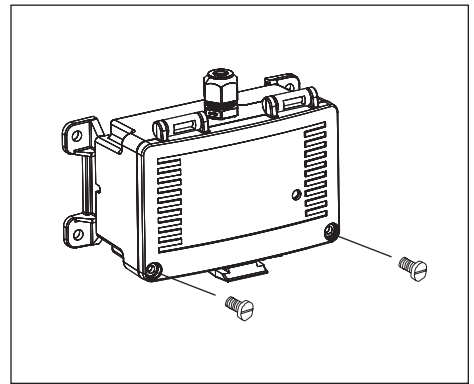

11 Use the provided security screws to secure the cover.

DIMENSIONS

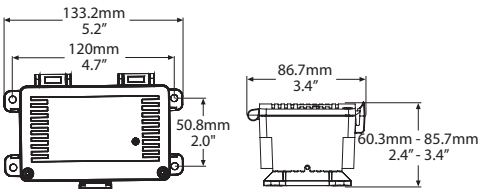

SPECIFICATIONS

POWER SUPPLY	12 - 27 Vac/dc
SUPPLY CURRENT	125 mA max @ 24 Vac
ALARM OUTPUT	2 Form C relay(s), NO/NC, rated 2 Amps @ 30 VAC/VDC, 0.5 Amps @ 120 VAC (resistive load)
VISUAL INDICATION	Tri-color LED - Green, Yellow, Red
OPERATING TEMPERATURE	0 to 50°C (32 to 122°F)
ENCLOSURE	ABS with hinged and gasket cover, IP65
DIMENSIONS	133.2mm L x 86.7mm W x 60.3-85.7mm H (5.2" x 3.4" x 2.4"- 3.4")
APPROVALS	CE, RoHS
COUNTRY OF ORIGIN	Canada