

**Introduction**

The RH200E series uses a highly accurate and reliable Thermostat Polymer based capacitance humidity sensor and state-of-the-art digital linearization and temperature compensated circuitry to monitor humidity levels in a duct. The humidity sensor is encapsulated in a 60 micron HDPE filter at the end of a 230 mm (9") S/S probe and a compact enclosure. An optional temperature sensor is available.

**Before Installation**

Read these instructions carefully before installing and commissioning the RH transmitter. Failure to follow these instructions may result in product damage. Do not use in an explosive or hazardous environment, with combustible or flammable gases, as a safety or emergency stop device or in any other application where failure of the product could result in personal injury. **Take electrostatic discharge precautions during installation and do not exceed the device ratings.**

**Mounting**

The RH200E transmitter installs directly into any air duct with a minimum width/diameter of 25.5 cm (10"). Select a suitable installation area in the middle of the duct wall. To achieve the best reading, do not place in an area where air stratification may be present. **Mount the sensor at least 1.5 m (5') in either direction from elbows, dampers, filters or other duct restrictions. Avoid areas where the transmitter is exposed to vibrations or rapid temperature changes.**

Once a suitable spot is selected, drill a 15 - 20 mm (0.6" - 0.75") hole for the probe.

Slide the probe in the drilled hole until the enclosure is flush against the duct. The airflow direction is not important. Secure the enclosure to the duct with (2) #10 x 25 mm (1") self tapping screws (Not provided). Tighten screws until the enclosure is tight against the duct and that there is no movement of the enclosure as shown in Figure 1.

A foam gasket on the back of the enclosure provides a tight seal against any air leaks.

Remove cover by grasping firmly with hand and twisting approximately a quarter turn counter-clockwise. A lanyard is attached between the cover and the box to allow the cover to hang during wiring and set up as shown in Figure 3.

A 21 mm (13/16") hole is provided for connection of either a 12.77mm (0.5") EMT connector or a cable gland style connector as shown in Figure 3. Insert the EMT or cable gland connector through the hole and securely fasten using a locknut. See Figure 4. **Special care must be taken not to damage any internal components during installation.**

To make wiring easier, the circuit board may be slid out. To do so, grasp firmly on the connectors and pull outward as shown in Figure 3. Make wire connections as per the "Wiring" illustrations on Page 2.

Once wiring and set up are complete, re-install cover and tighten by twisting clockwise.

Figure 1

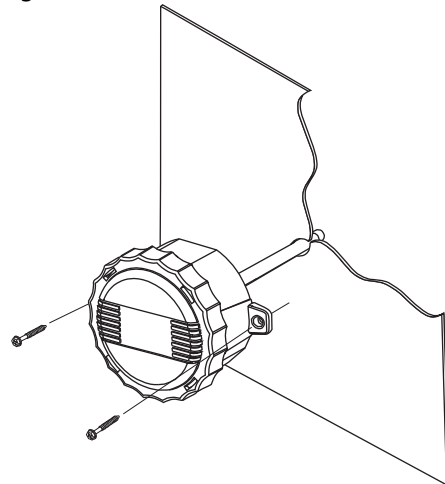


Figure 2




Figure 3







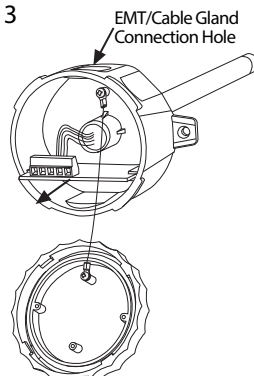


Figure 4

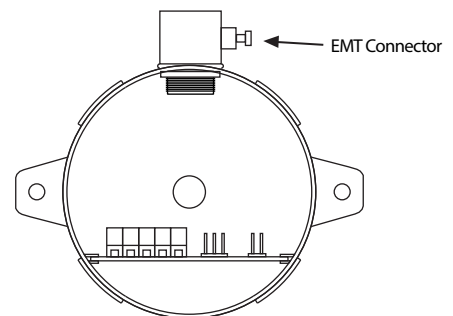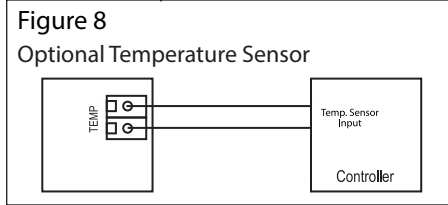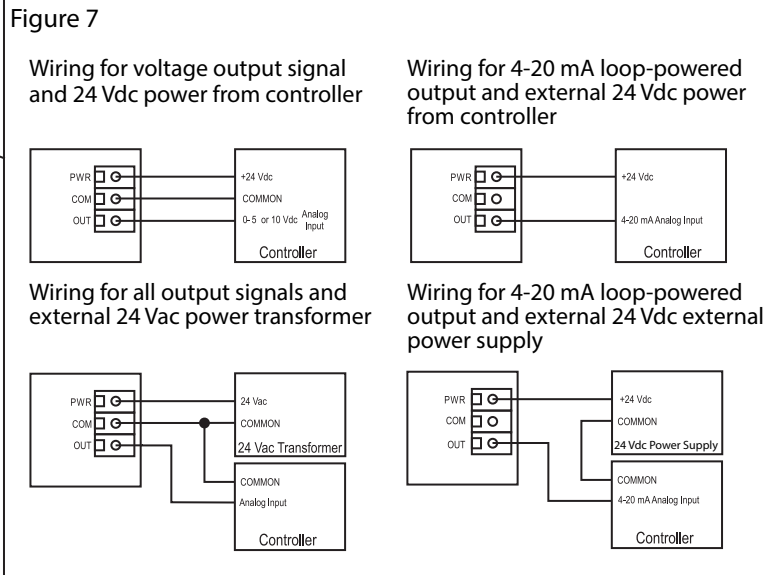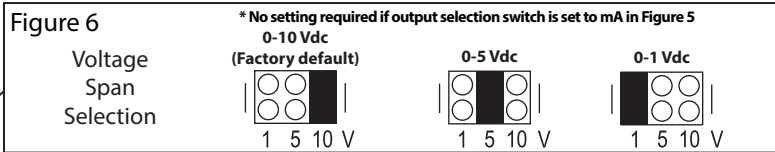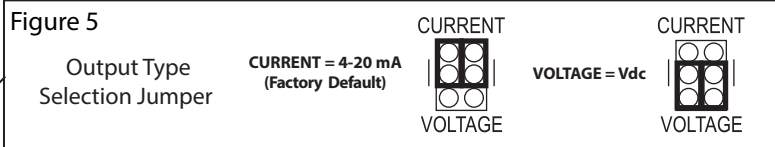

## Wiring

- Deactivate the 24 Vac/dc power supply until all connections are made to the device to prevent electrical shock or equipment damage.
- Use 14-22 AWG shielded wiring for all connections and do not locate the device wires in the same conduit with wiring used to supply inductive loads such as motors. Make all connections in accordance with national and local codes.
- Pull at least six inches of wire into the enclosure, then complete the wiring connection according to the wire diagram for the applicable power supply and output signal type.
- Select desired signal output type by placing the output jumper in required position, as shown in Figure 5. (Factory default is CURRENT) **Please note that pin connection tabs in jumper must be in vertical position.**
- If Voltage output is required, place Voltage Span Jumper to desired span position, as shown in Figure 6. ie: 10 = 0-10 Vdc. (Factory default is 10 = 0-10 Vdc)
- Connect the DC positive or the AC voltage hot side to the PWR terminal. For voltage output or AC power, the supply Common is connected to the COM terminal. The device is reverse voltage protected and will not operate if connected backwards. It has a half-wave power supply so the supply Common is the same as the signal Common as shown in Figure 7.
- The analog output is available on the OUT terminal. Check the controller Analog Input to determine the proper connection before applying power as shown in Figure 7.
- If installed, the resistance temperature sensor output is available on the two terminals labelled TEMP as shown in Figure 8.

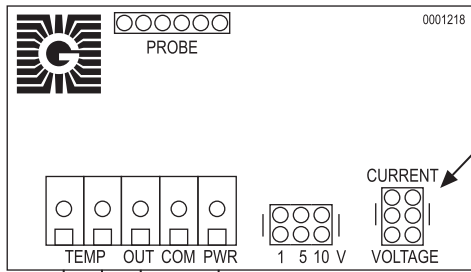

### Specification:

Sensor Type:.....Thermoset Polymer based Capacitive  
 Range:.....0 to 100% RH  
 Accuracy:.....±2, 3, or 5% RH (5 to 95% RH)  
 Response:.....15 Seconds typical  
 Temp Dependence:.....±0.05% RH/ °C  
 Hysteresis:.....±1.5% RH maximum  
 Repeatability:.....±0.5% RH typical  
 Linearity:.....±0.5% RH typical  
 Operating Range:.....-40 to 85°C (-40 to 185°F)  
 Power Supply:.....18 to 30 Vdc, 15 to 26 Vac  
 Consumption:.....22 mA maximum  
 Protection Circuitry:....Reverse voltage protected and output limited  
 Output Signal:.....4-20 mA current loop, 0-1, 0-5 or 0-10 Vdc (jumper-selectable)  
 Output Drive @ 24 Vdc:..550 ohms max for current output  
 10K ohms min for voltage output  
 Internal Adjustments:..Clearly marked ZERO and SPAN pots  
 Optional Temp:.....RTD's or Thermistors. 2 Wire  
 Probe:.....230 mm (9") probe length x 12.7 mm (1/2") diameter stainless steel with 60 micron HDPE porous filter  
 Enclosure:.....ABS - UL94-5VB - IP65 (NEMA 4X)  
 \*In order to maintain the published NEMA/IP ratings, properly rated conduit or cable gland adapters must be used.  
 Termination:.....Screw terminal block (14 to 22 AWG)

### Dimensions:

