



GREYSTONE ENERGY SYSTEMS INC

HIGH ACCURACY DUCT AVERAGE TEMPERATURE SENSOR HATSDC Series

The high accuracy flexible multi-point duct averaging temperature sensor utilizes several precision sensors spaced at equal distances and encapsulated in a 7.94 mm (0.3125") OD, soft copper probe, it is available in various lengths (see ordering chart). All probes provide excellent heat transfer, fast response and resistance to moisture penetration.



SPECIFICATION:

Sensor Type..... Various Thermistors or RTD
 Sensor Accuracy..... **RTD Class A:** $\pm 0.15^{\circ}\text{C}$ @ 0°C
 RTD 1/3 DIN: $\pm 0.1^{\circ}\text{C}$ @ 0°C
 RTD 1/10 DIN: $\pm 0.03^{\circ}\text{C}$ @ 0°C
 NTC Thermistor Type 39: $\pm 0.05^{\circ}\text{C}$, 0 to 70°C
 NTC Thermistor Type 55: $\pm 0.03^{\circ}\text{C}$, 0 to 70°C
 NTC Thermistor Type 40/46: $\pm 0.1^{\circ}\text{C}$, 0 to 70°C
 Temperature Range..... -20 to 60°C (-4 to 140°F)
 Wire Material..... FT-6 rated Plenum cable, 22 AWG
 Probe Material..... Soft copper
 Probe Diameter..... 7.94 mm (0.315")
 Standard Lengths..... 1800, 3600, 6100, 7200 mm
 (6', 12', 20', 24')
 Enclosure..... ABS - UL94-V0, IP65 (NEMA4X)
 C - includes terminal block
 E - includes thread adapter (1/2" NPT to M16),
 cable gland fitting, and terminal block
 Termination..... A - Pigtail, 2 or 3 wire
 C & E - terminal block, 2 or 3 wire
 Country of Origin..... Canada

PART NUMBER SELECTED

PRODUCT SELECTION INFORMATION:

MODEL	Product Description
HATSDC	High Accuracy Flexible Copper Duct Average Temperature Sensor

CODE	Enclosure
A	ABS, with hinged & gasketed cover
C	Same as A, with terminal block
E	Same as C, with thread adapter and cable gland fitting

CODE	Sensor
18	1000 Ω Platinum, IEC 751, 385 Alpha, thin film, Class A
48	1000 Ω Platinum, 2 wire, IEC 751, 385 Alpha, thin film, 1/3 DIN
22	1000 Ω , Platinum, 2 wire, IEC 751, 385 Alpha, thin film, 1/10 DIN
41	1000 Ω , Platinum, 3 wire, IEC 751, 385 Alpha, thin film, Class A
49	1000 Ω , Platinum, 3 wire, IEC 751, 385 Alpha, thin film, 1/3 DIN
50	1000 Ω Platinum, 3 wire, IEC 751, 385 Alpha, thin film, 1/10 DIN
39	10,000 Ω Type 2, NTC Thermistor, $\pm 0.05^{\circ}\text{C}$
55	10,000 Ω , Type 2, NTC Thermistor, $\pm 0.03^{\circ}\text{C}$
40	10,000 Ω , Type 3, NTC Thermistor, $\pm 0.1^{\circ}\text{C}$
46	20,000 Ω , NTC Thermistor, $\pm 0.1^{\circ}\text{C}$

CODE	Probe Length
I	1800 mm (6')
J	3600 mm (12')
K	6100 mm (20')
L	7300 mm (24')


Greystone Energy Systems, Inc. reserves the right to make design modifications without prior notice.

TYPICAL INSTALLATION:


For complete installation and wiring details, please refer to the product installation instructions.

The duct average probes are installed through a hole in the side of the duct to monitor an average temperature within the duct. Select a probe length that allows for criss-crossing the duct multiple times. Install the probes in a straight section of duct at a suitable distance downstream from any heating, cooling or humidification devices.

Each enclosure style provides mounting tabs for ease of installation.




DIMENSIONS:

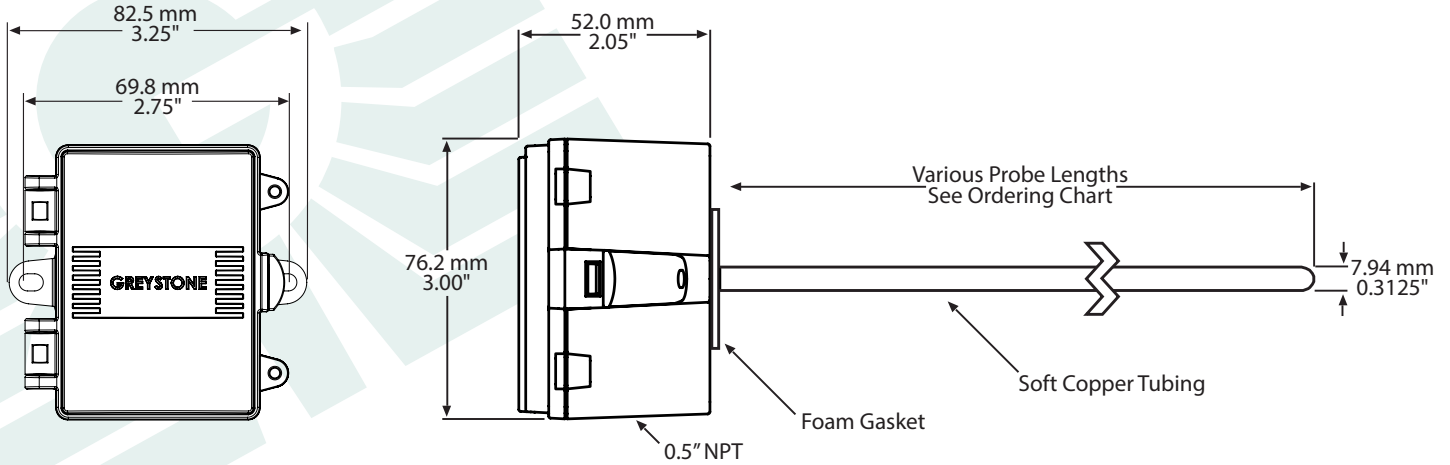

Included with E style enclosure

Thread Adapter



Cable Gland Fitting



GREYSTONE

ENERGY SYSTEMS INC

Greystone Energy Systems, Inc.

150 English Drive, Moncton,
New Brunswick, Canada E1E 4G7

(506) 853-3057 Fax: (506) 853-6014

North America: 1-800-561-5611

e-mail: mail@greystoneenergy.com

www.greystoneenergy.com

RoHS
COMPLIANT



Greystone Energy Systems Inc. is one of North America's largest ISO registered manufacturers of HVAC/R sensors and transmitters for Building Automation Management Systems.

We have conscientiously established a worldwide reputation as an industry leader by maintaining leading-edge design technology, prompt technical support, and a commitment to on-time deliveries. We take pride in our Quality Management System which is ISO 9001 certified, assuring our customers of consistent product reliability.

GREYSTONE HAS AN **ISO 9001** REGISTERED QUALITY SYSTEM