



# GREYSTONE ENERGY SYSTEMS INC

## ROOM CARBON DIOXIDE DETECTOR w/ BACnet® or ModBus Communications CDD3 Series

The CDD3 series uses a highly accurate and reliable Non-dispersive Infrared (NDIR) sensor combined with state-of-the-art digital linearization and temperature compensated circuitry in an attractive, low profile enclosure for room applications to monitor room CO<sub>2</sub> levels. A BACnet or Modbus Communications signal is provided for connection to a building automation system. Optional features such as temperature, humidity, setpoint adjustment, manual override and adjustable relay output are available.

### SPECIFICATION:

Power Supply.....	20-28 Vac/dc (non-isolated half-wave rectified)
Consumption.....	80 mA max @ 24Vdc, 140 mA max @ 24Vac with all options
Protection Circuitry.....	Reverse voltage protected, overvoltage protected
Operation Conditions.....	0°-50°C (32°-122°F), 0-95% RH non-condensing.
Sensor Coverage Area.....	100 m <sup>2</sup> (1000 ft <sup>2</sup> ) typical
Wiring Connections.....	Screw terminal block (14 to 22 AWG)
External Dimensions.....	84mm W x 119mm H x 29mm D (3.3" x 4.7" x 1.15")
Enclosure Ratings.....	IP30 (NEMA 1)

### CO2 Signal:

Measurement Type.....	Non-Dispersive Infrared (NDIR), diffusion sampling
Range.....	0 - 2000 ppm
Standard Accuracy.....	±30 PPM @ 1000 ppm @ 22°C (72°F) when compared to certified calibration gas
Temperature Dependence.....	0.2% FS per °C
Stability.....	< 2 % FS over life of sensor (15 years typical)
Pressure Dependence.....	0.13% of reading per mm Hg
Altitude Correction	Programmable from 0-5000 ft via BACnet® or ModBus
Response Time.....	<2 minutes for 90% step change typical
Warm-up Time.....	<2 minutes

### BACnet® Interface:

Hardware.....	2-wire RS-485
Software.....	Native BACnet® MS/TP protocol
Baud Rate.....	Locally set to 9600, 19200, 38400 or 76800
MAC Address Range.....	Locally set to 0-127 (factory default is 3), (63 devices max on one daisy chain)

### ModBus Interface:

Hardware.....	2-wire RS-485
Software.....	Native ModBus MS/TP protocol (RTU or ASCII)
Baud Rate.....	Locally set to 300, 600, 1200, 2400, 4800, 9600, 19200, 38400, 57600, 76800 or 115200
Slave Address Range.....	Locally set to 0-64 (factory default is 1), (32 devices max on one daisy chain)

### Optional Temperature Signal:

Sensing Element.....	10K thermistor, ±0.2°C (±0.4°F)
Resolution.....	0.1°C (0.2°F)
Range.....	0° to 35°C (32° to 95°F)

### Optional RH Signal:

Sensing Element.....	Thermoset polymer based capacitive
Accuracy.....	± 2% RH
Range.....	0 - 100% RH, non-condensing
Resolution.....	1% RH
Hysteresis.....	± 3% RH
Response Time.....	15 seconds typical
Stability.....	± 1.2% RH typical @ 50% RH in 5 years



### PART NUMBER SELECTED

### PRODUCT SELECTION INFORMATION:

MODEL	Product Description
CDD3A10	Room Carbon Dioxide Sensor w/ BACnet® Communications
CDD3B10	Room Carbon Dioxide Sensor, w/ Modbus Communications

CODE	Display
0	Concealed
1	Viewable

CODE	Configurations
-	CO <sub>2</sub> Only
RH	CO <sub>2</sub> , Humidity & Temperature
T	CO <sub>2</sub> & Temperature

CODE	Options (Multiple selections can be made) (Leave blank if no options required)
P	Setpoint control, 2 button up/down
S	Exposed push button momentary switch - N.O.
R	Relay Output

### Optional Relay Output:

Contact Ratings.....	Form A contact (N.O.), 2 Amps @ 140 Vac, 2 Amps @ 30 Vdc
Relay Trip Point.....	Programmable 500-1500 ppm via BACnet® or ModBus
Relay Hysteresis.....	Programmable 25-200 ppm via BACnet® or ModBus

### Optional LCD Display:

Resolution.....	1 ppm CO <sub>2</sub> , 1% RH, 1°C (1°F)
Size.....	1.4" w x 0.6" h (35 mm x 15 mm) alpha-numeric 2 line x 8 character
Backlight.....	Enable or disable via keypad

**Optional Override Switch** Front panel push-button available as BACnet® object or ModBus register


**Optional Setpoint Control**..... Front panel push-buttons available as 0 to 100% as BACnet® object or ModBus register

## TYPICAL INSTALLATION:


For complete installation and wiring details, please refer to the product installation instructions.

The CDD3 series can be mounted directly to a single gang electrical box or directly to a wall. The backplate includes many mounting hole configurations to allow for mounting on a variety of electrical boxes.

The basic CDD3 has a screw block terminal provided for connection to the Building Automation System.

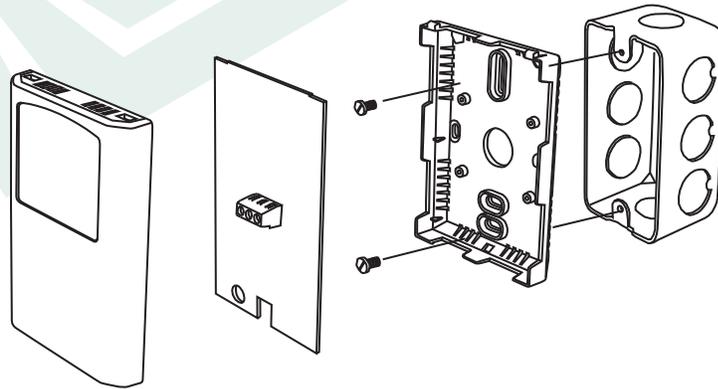

## DIMENSIONS:

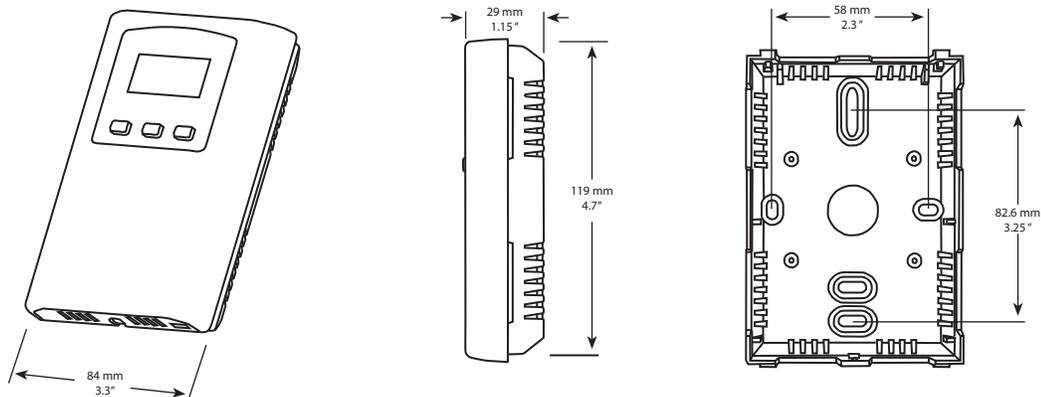

## 5-YEAR CALIBRATION GUARANTEE

Based on the results of years of testing of ACLP software, Greystone now offers a 5-year calibration guarantee on all its CDD series wall and duct mount sensors used for CO<sub>2</sub> based ventilation control when operated in an environment that can utilize ACLP software. If the sensor is found to be out of calibration more than 150 PPM as compared to a calibration gas or recently calibrated reference, Greystone will provide a free factory calibration of the sensor if returned to Greystone. This guarantee only applies if the sensor is operated in an environment where inside levels periodically drop to outside concentrations (i.e. during evenings or weekends when there is no occupancy) as is required by ACLP software.



Greystone Energy Systems Inc.  
150 English Drive, Moncton,  
New Brunswick, Canada E1E 4G7

(506) 853-3057 Fax: (506) 853-6014  
North America: 1-800-561-5611  
e-mail: mail@greystoneenergy.com  
web site: www.greystoneenergy.com

RoHS  
COMPLIANT



*Greystone Energy Systems Inc. is one of North America's largest ISO registered manufacturers of HVAC/R sensors and transmitters for Building Automation Management Systems.*

*We have conscientiously established a worldwide reputation as an industry leader by maintaining leading-edge design technology, prompt technical support, and a commitment to on-time deliveries. We take pride in our Quality Management System which is ISO 9001 certified, assuring our customers of consistent product reliability.*

GREYSTONE HAS AN ISO 9001 REGISTERED QUALITY SYSTEM