


LOW LIMIT STRAP-ON TEMPERATURE THERMOSTAT TLRP Series

The TTLRP single point strap-on temperature thermostat incorporates a precision thermistor temperature sensor and provides a Form C relay output (NO/NC) with an adjustable setpoint. The sensor is encapsulated in a 6.35 mm (0.25") OD, 304 stainless steel probe and is available in various lengths (see ordering chart). Standard wire length is 5' (1.5 m). All probes are constructed to provide excellent heat transfer, fast response and are potted to resist moisture penrtration. Two enclosure styles are available.

SPECIFICATION:

SI ECII ICALIOII.
Power Supply 12 to 28 Vac/dc
Consumption50 mA max
Relay Contacts
Relay Action Activates on temperature fall
Setpoint Operation Single-turn knob-pot on pcb
Adjustable Setpoint4 to 10°C (25 to 50°F)
Setpoint Temperature Low/Mid/High jumper selectable Differential 1.1/2.8/5.6 °C (2/5/10 °F)
Temperature Sensor10K ohm curve matched precision thermistor
Sensor Accuracy ±0.2°C, 0 to 70°C (±0.36°F, 32 to 158°F)
Probe Sensing Range20 to 105 °C (-4 to 221 °F)
Probe Material 304 Series Stainless Steel
Probe Dimensions 6.35 mm (0.25") Diameter
Wire MaterialPVC insulated parallel bonded
Wire Length 1.524 m (57)
Operating Conditions10 to 5 C (14 to 122°F), 5 to 95% RH non-condensing
Storage Conditions30 to 70°C (-22 to 158°F),
5 to 95%RH, non-condensing
Enclosure(A) ABS, UL94-5VB, IP61 (NEMA 2) (D)-ABS, UL94-5VB, IP65 (NEMA 4X)
Wiring ConnectionsScrew terminal block

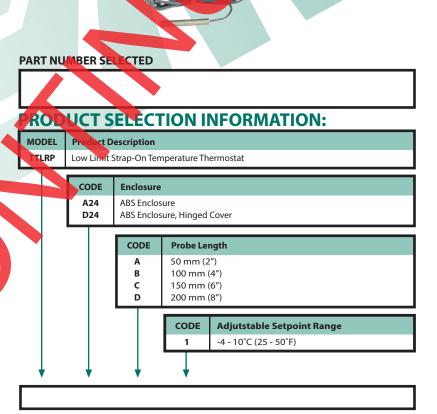

WIRIN

Terminal unction **PWR** wer Supply ower Supply Common COM


TEMP (2) Temperature Sensor Input

NO Relay Output - Normally Open Contact

(14 to 22 AW)

COM Relay Common

NC Relay Output - Normally Closed Contact















For best results, thermal conductive compound should be applied to pipe prior to mounting the probe.

Find a suitable location along the pipe where both the probe and remote enclosure can be mounted. If necessary, remove a section of insulation from pipe. Position probe directly on the pipe and secure using a pipe clamp. For added security, make 1-3 loops of the sensor cable around the pipe and feed through wire hole on the enclosure and secure using the supplied grommet. If necessary, the pipe insulation can be re-applied to the pipe over the probe.




DIMENSIONS:

ABS Enclosure (A)

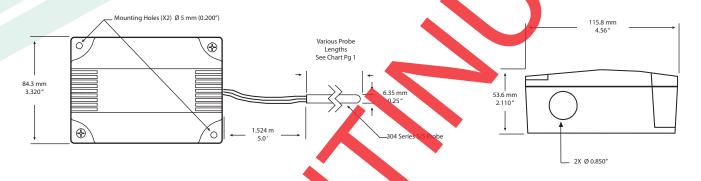

Hinged ABS Enclosure (D)

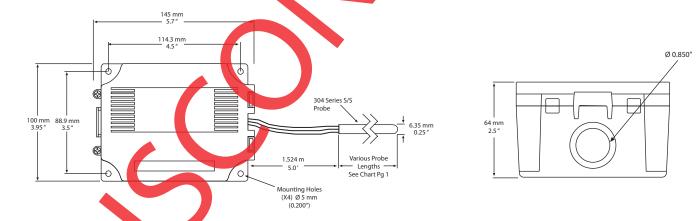

Greystone Energy Systems, Inc. reserves the right to make design modifications without prior notice.



Greystone Energy Systems, Inc. 150 English Drive, Moncton, New Brunswick, Canada E1E 4G7

(506) 853-3057 Fax: (506) 853-6014 North America: 1-800-561-5611 e-mail: mail@greystoneenergy.com www.greystoneenergy.com











transmitters for Building Automation Management Systems. We have conscientiously established a worldwide reputation as an industry leader by maintaining leadingedge design technology, prompt technical support, and a commitment to on-time deliveries. We take pride in our Quality Management System which is ISO 9001 certified, assuring our customers of consistent product reliability.